

Title 14, §17867(a)(8)

Fire

Title 14, §17867(a)(8)



FIRE PREVENTION

Temperature monitoring,

Adequate water supply,

Isolation of potential ignition sources,

Fire lanes for fire equipment access

FIRE PREVENTION

Temperature monitoring





FIRE PREVENTION

Adequate water supply

FIRE PREVENTION

Isolation of ignition sources






16. Sketch the area where the fire originated

Distance measured by: Tape

Pace

Estimate

Not to Scale

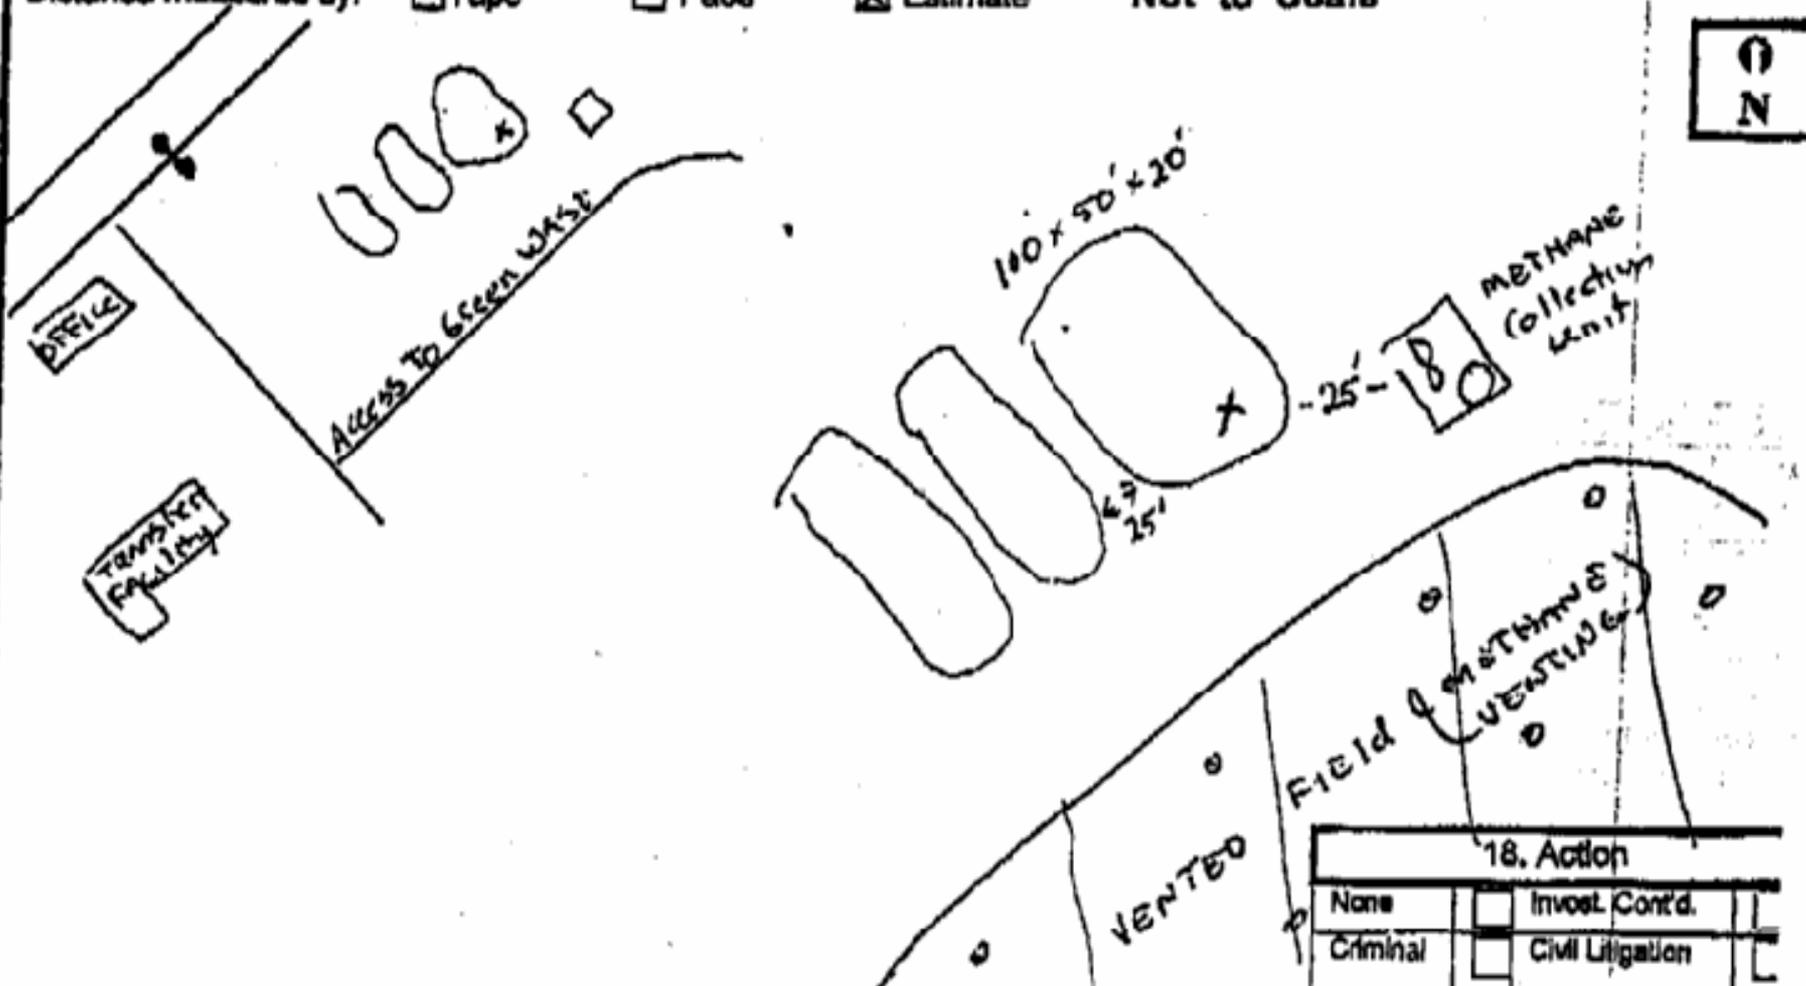

18. Action

None	<input type="checkbox"/> Invest. Cont'd.
Criminal	<input type="checkbox"/> Civil Litigation

Pile Size and Location Issues

FIRE PREVENTION

Fire lanes for fire equipment access









T14, §17867 (a) (8) “The operator shall provide fire prevention, protection and control measures, including, but not limited to, temperature monitoring of windrows and piles, adequate water supply for fire suppression, and the isolation of potential ignition sources from combustible materials. Firelanes shall be provided to allow fire control equipment access to all operation areas”.